


PLAN

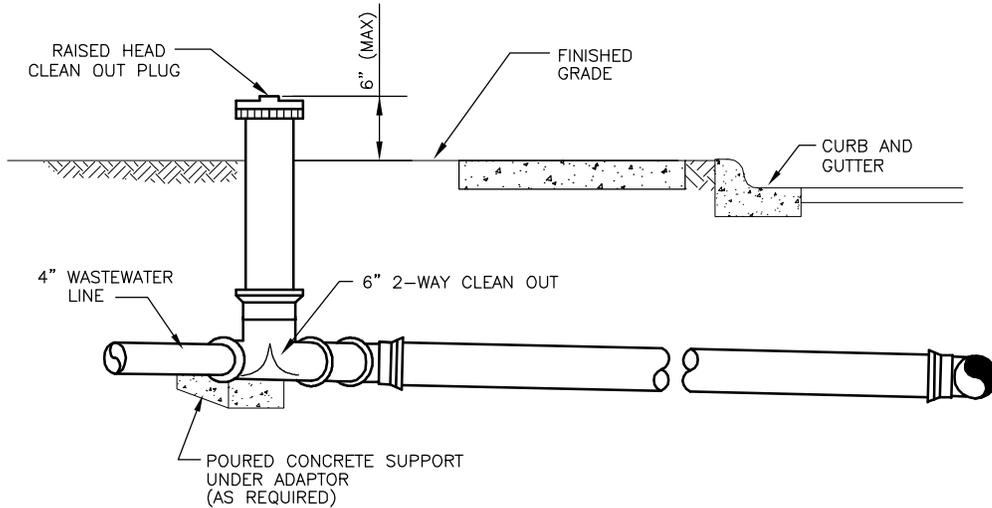

**NOTE:**

1. LOCATION OF CLEAN OUT RISER TO BE 1 FT EITHER SIDE OF PROPERTY LINE. NO RISERS ARE TO BE PLACED IN THE SIDEWALK.
2. UTILITY CONTRACTOR INSTALLS WASTEWATER CONNECTION TO MAIN, 6" STUB, 6" SERVICE BRANCH WITH 2-WAY CLEANOUT AND RISER FOR CLEANOUT, AND PLUGS. ALL WASTEWATER PIPING TO HAVE ELSTOMERIC GASKET TYPE JOINTS AND TO SLOPE DOWNWARD TO MAIN 1% (1/8") PER FOOT.
3. CUSTOMER REMOVES PLUG FROM 2-WAY CLEANOUT AT PROPERTY LINE, INSTALLS 6" X4" ELASTOMERIC GASKETED BELL REDUCER. AS AN ALTERNATE, CUSTOMER MAY INSTALL MINIMUM 16" LENGTH OF 6" PIPE, LAY 4" PIPE (EXTEND 6" MINIMUM INTO 6" PIPE) AND JOINT WITH FLEXIBLE ADAPTER AND CAST IN PLACE CONCRETE SUPPORT BLOCK UNDER FLEXIBLE ADAPTER. BLOCK TO HAVE MINIMUM DIMENSIONS OF 6" THICK AND 18" WIDE AND EXTEND A MINIMUM OF 6" BEYOND EITHER END OF ADAPTER.
4. CITY OF LAMPASAS ACTIVITY IS LIMITED TO THE INSPECTION OF CONNECTIONS TO THE CITY'S WASTEWATER SYSTEMS. FOR MAINTENANCE PURPOSES, THE CITY'S RESPONSIBILITY ENDS AT THE CUSTOMERS WASTEWATER CONNECTION TO THE 2-WAY CLEANOUT. PIPING IN STREET RIGHT-OF-WAY AND IN EASEMENT AREA IS TO BE BEDDED IN GRANUALR MATERIALS AS REQUIRED BY THE CITY'S STANDARD SPECIFICATIONS

DETAIL DEPICTS DIMENSIONAL REQUIREMENTS. THE ARCHITECT/ENGINEER ASSUMES RESPONSIBILITY FOR THE APPROPRIATE USE OF THIS STANDARDS.



DUAL SERVICE  
TWO WAY CLEANOUT  
AT PROPERTY LINE

STANDARD CONSTRUCTION DETAILS  
WASTEWATER

DATE: MARCH 2007	SCALE: NTS	SHEET: SD-SS03B
---------------------	---------------	--------------------