
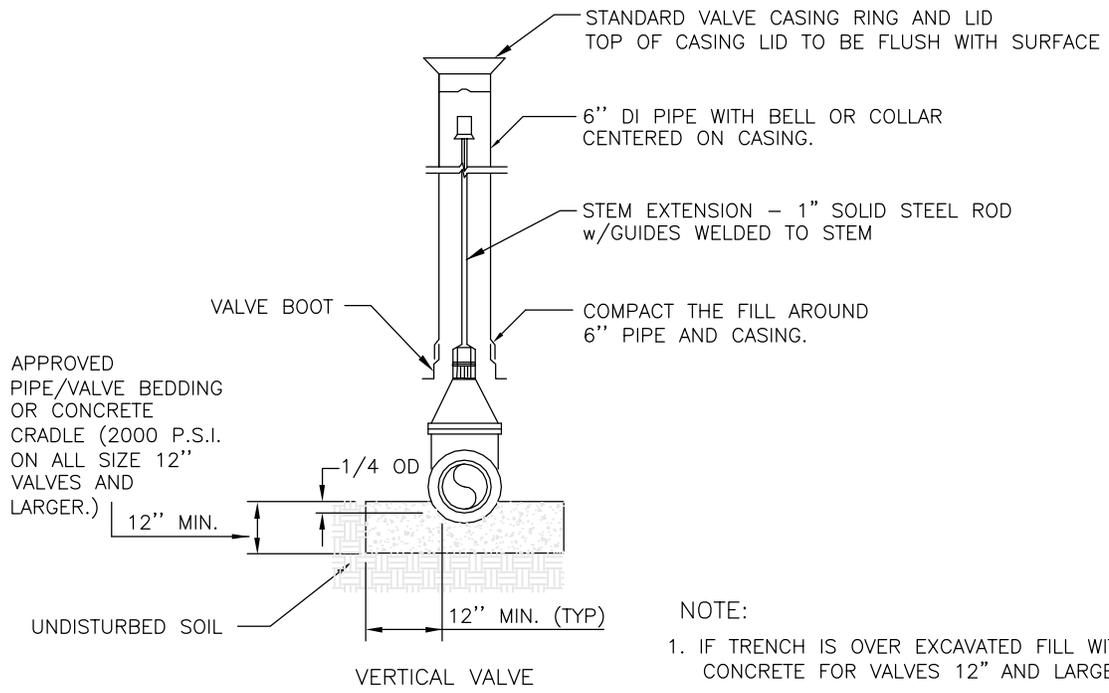


NOTES:

1. WELD SOCKET 2 5/8" X 1 1/4" DEEP TO 1" SOLID ROUND STEM EXTENSION FITTED ON OPERATING NUT.
2. NUT AT TOP OF VALVE EXTENSION ROD SHALL BE 2" SQUARE 1 1/2" LONG WELDED TO TOP OF ROD.

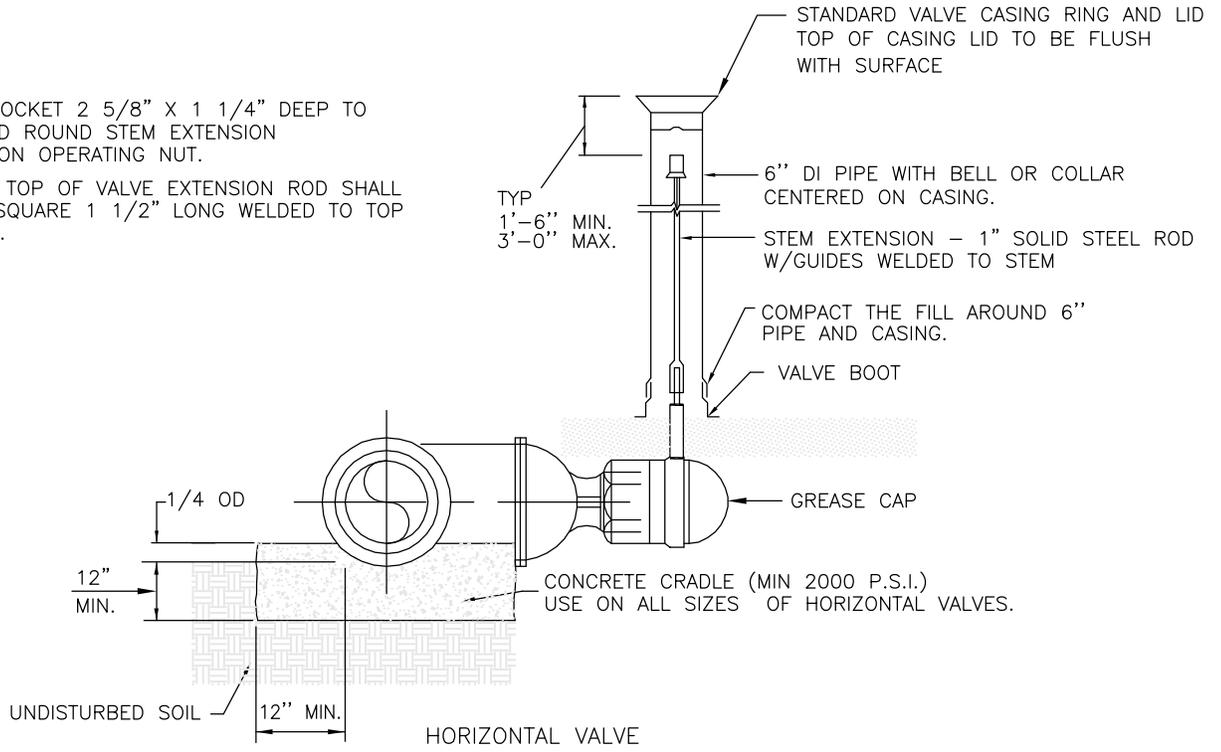

NOTE:

1. IF TRENCH IS OVER EXCAVATED FILL WITH CONCRETE FOR VALVES 12" AND LARGER.

DETAIL DEPICTS DIMENSIONAL REQUIREMENTS.
THE ARCHITECT/ENGINEER ASSUMES RESPONSIBILITY
FOR THE APPROPRIATE USE OF THIS STANDARDS.



TYPICAL GATE VALVE 4"-24"

STANDARD CONSTRUCTION DETAILS
WATER

DATE:
MARCH 2007

SCALE:
NTS

SHEET:
SD-W05