


BONNET TO FLANGE AND NOZZLE CAPS COLOR CODE FOR MAIN SIZE AS NOTED BELOW. REMAINDER OF HYDRANT ABOVE GROUND TO BE PAINTED RED

NOTE: FIRE HYDRANT TO BE SET PLUMB.

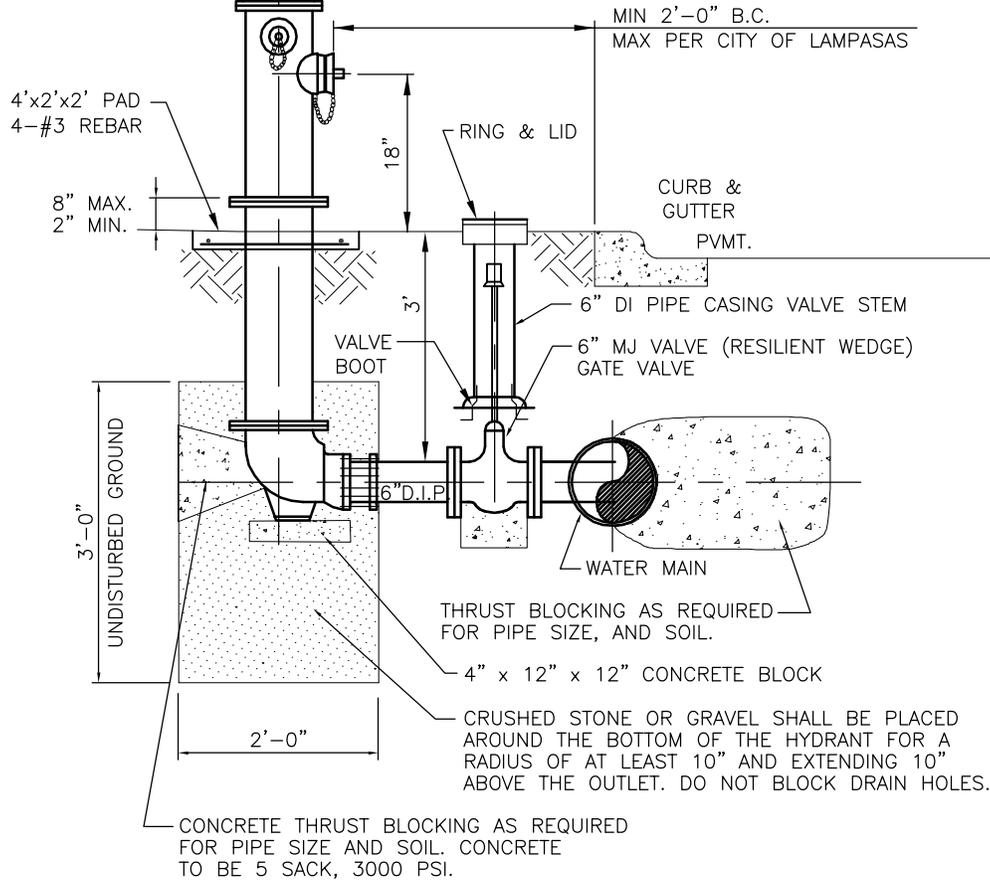

**NOTES:**

1. ALL PIPE FITTINGS & HYDRANT TO BE WRAPPED IN BLACK POLYETHYLENE (8MIL)
2. PRESSURE TESTING TO BE AGAINST CLOSED HYDRANT VALVE.
3. A BLUE STIMSONITE FIRE-LITE REFLECTOR (OR APPROVED EQUAL) TO BE PLACED IN CENTER OF EACH STREET OPPOSITE EACH FIRE HYDRANT. INSTALLATION TO BE PER REFLECTOR MANUFACTURER'S RECOMMENDATION.

WATER MAIN SIZE	FIRE HYDRANT BONNET COLOR
4"	RED
6"	SILVER
8"	BLUE
10" & LARGER	YELLOW

DETAIL DEPICTS DIMENSIONAL REQUIREMENTS. THE ARCHITECT/ENGINEER ASSUMES RESPONSIBILITY FOR THE APPROPRIATE USE OF THIS STANDARDS.



FIRE HYDRANT

STANDARD CONSTRUCTION DETAILS  
WATER

DATE:  
MARCH 2007

SCALE:  
NTS

SHEET:  
SD-W09